# **UWP 3.0**





#### **Description**

UWP 3.0 is a monitoring gateway and controller that allows the monitoring and controlling of installations where Energy Efficiency Management and Building Automation functions are needed.

The system monitors and controls connected devices via its local bus management functions; it includes a web server with a powerful and intuitive user interface to display customised dashboards and interact with local devices and remote systems; the UWP 3.0 embedded automation server allows data to be exchanged locally or remotely via standard Internet protocols.

UWP 3.0 can manage the complete lighting control system based on DALI actuators and it can operate as a BACnet/IP gateway.

#### **Benefits**

- Flexibility. UWP 3.0 is the core of a powerful system which includes a complete range of meters, sensors and actuators
- Integration. UWP 3.0 includes all the necessary software tools to set up and operate the required solution. No subscriptions or additional services are required
- Interoperability. By leveraging its automationserver functions, it is easy to exchange data with other systems via FTP, SFTP, FTPS, SMTP, Rest-API, MQTT, Sentilo, Modbus and BACnet
- Scalability. It is easy to scale up the system, by leveraging its comprehensive set of monitoring, controlling and communication functions
- Fast installation and set up. Each function can be programmed with ease by means of the free configuration tool
- Reliability. The system is secure against cyber-attacks and computer viruses. It is the ideal Edge unit for providing local control and data redundancy to distributed applications
- High storage capability. Thanks to its 4GB of Storage memory, UWP 3.0 can store complex configurations and log history and events
- **Microsoft Azure Certified**: UWP 3.0 is pretested and certified to work with Azure IoT.
- **Powered by AWS**. UWP 3.0 is compatible with Amazon AWS IoT.
- Awareness. By means of scheduled reports and email/SMS alerts, users are constantly advised about installation status
- Compact Size. All of the above is available in a 2 DIN module
- Powered by MAIA Cloud: secure and reliable system for remotely managing, setting and operating UWP 3.0 units Worldwide.



# References

### Compatible devices

Device	Instruction manual
UWP-MODEM-KIT-4G-E01	www.gavazziautomation.com/UWP-Modem-Kit-4G-E01.pdf
UWP-MODEM-KIT-4G-E02	www.gavazziautomation.com/UWP-Modem-Kit-4G-E02.pdf



## Further information

Document	Where to find it
UWP 3.0 Tool user manual	www.gavazziautomation.com/Tool_ENG.pdf
UWP 3.0 Web App user manual	www.gavazziautomation.com/WebApp_ENG.pdf
MAIA Cloud system user manual	www.gavazziautomation.com/MAIA_Cloud_EIM.pdf
Hardware manual	www.gavazziautomation.com/System_ENG.pdf
Wireless manual	www.gavazziautomation.com/Wireless_ENG.pdf
Set up a Microsoft-Azure IoT-based system	www.gavazziautomation.com/MicrosoftAzure.pdf
UWP 3.0 how to order	www.productselection.net/UWP3_how_to_order.pdf
UWP 3.0 Cybersecurity guideline	www.gavazziautomation.com/CybersecurityGuideline.pdf
UWP 3.0 quick connection guide	www.gavazziautomation.com/Quick_guide.pdf



### MAIA Cloud licences

Information	Description	Document
UWP-LICENCE-M01B	MAIA PLUS LICENCE-12 MONTHS VPN	
UWP-LICENCE-M02B	MAIA PLUS LICENCE-24 MONTHS VPN	MAIA Licence A4 pdf
UWP-LICENCE-M04B	MAIA PLUS LICENCE-48 MONTHS VPN	Licence Code EIM pdf
UWP-LICENCE-M05B	MAIA PLUS LICENCE-60 MONTHS VPN	Licerice Code Elivi pai
UWP-LICENCE-M25B	MAIA PLUS LICENCE-300 MONTHS VPN	
UWP-ACTIVATION-KEY	MAIA ACTIVATION LICENCE	MAIA Activation A4 pdf
OWF-ACTIVATION-RET	INAIA ACTIVATION LICENCE	Activation Key EIM pdf



### How to order

Component code	Description			
UWP30RSEXXX	Monitoring gateway and controller			
UWP30RSEXXXSE	Monitoring gateway and controller security enhanced			



#### **Applications**

UWP 3.0 is suitable for applications in Building Automation, Energy Efficiency Performance Management and all their combinations are suitable application for UWP 3.0. Its comprehensive set of functions, small dimensions and reliability are the key factors for depending on UWP 3.0 as the local monitoring/controlling unit in a wider distributed scenario.



#### **Main functions**

- Acting as a gateway for sharing data and receiving remote commands via BACnet, Modbus TCP/IP and Rest-API
- Monitoring energy control systems so as to check energy efficiency status and improvements.
- Recording, displaying and transmitting information (events and history)
- Defining logical functions, reacting to abnormal conditions and control actuators
- · Setting up and operating Building Automation functions
- · Setting up and operating Lighting Control functions and DALI




#### **Main features**

- Up to 5000 managed signals (including variables, I/Os) shared among Energy Management and Building Automation applications.
- Up to 128 Modbus devices connected to RS485 ports (64 devices each port).
- Up to 5 users concurrently connected to the Web-App.
- Up to 5 concurrent M2M connections (API connections, BACnet clients, Modbus masters).
- Up to 150 different products from the Carlo Gavazzi range can be connected to UWP 3.0
- BTL certified (max 500 BACnet points for used BACnet objects).




# **Architecture**

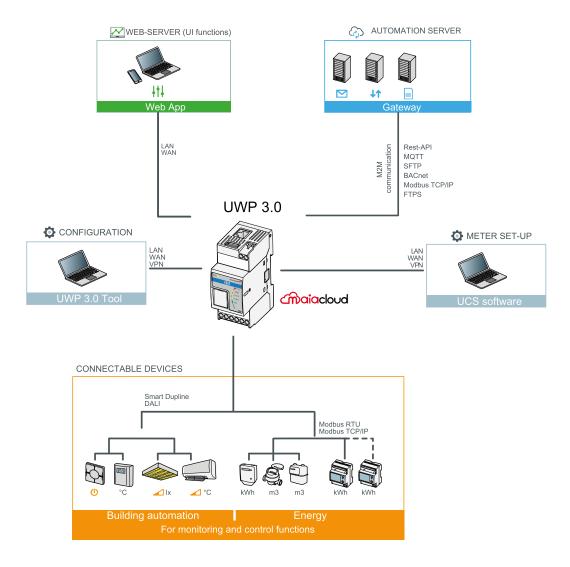



### Structure

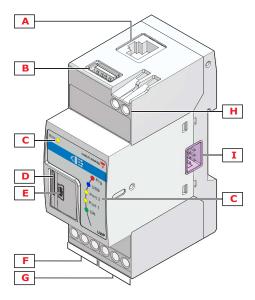

Area	Description
Α	Ethernet port
В	USB port (Host function)




Area	Description
	Indication LEDs:
	Green (ON):
	ON - Power ON
	OFF - Power OFF
	Yellow (BUS):
	ON - Communication ON on the HS-bus
	OFF - No communication is present on the HS-bus
	Flashing - Communication error on the HS-bus
	Yellow (Port 1):
	OFF - Communication disabled
	Flashing 200 ms ON, 600 ms OFF - No communications on RS485 COM1
С	Flashing 200 ms ON, 200 ms OFF - Communications OK
	Yellow (Port 2):
	OFF - Communication disabled
	Flashing 200 ms ON, 600 ms OFF - No communications on RS485 COM2
	Flashing 200 ms ON, 200 ms OFF - Communications OK
	Blue (USB):
	ON - USB device is present
	OFF - No USB device is present
	Red (Prg):
	ON - No configuration is present
	OFF - Configuration present in the UWP
	Flashing - UWP is connected to the UWP 3.0 Tool
D	Micro SD memory card slot
E	Mini-USB port (Device function)
F	RS485 COM1 port terminals
G	RS485 COM2 port terminals
Н	Power supply connection block
ı	Local bus ports (left side and right side)



# **Features**

#### General

Material	Noryl, self-extinguishing V-0 (UL94)			
Dimensions	2-DIN module			
Weight	150 g			
Protection degree	Front: IP40; Screw terminals: IP20			
Dielectric strength	4000 V AC RMS for 1 minute			
Rejection (CMRR)	>65 dB, from 45 to 65 Hz			
Tauminala	8, screw-type			
Terminals	Section: 1.5 mm <sup>2</sup> maximum; Torque: from 0.4 to 0.8 Nm			

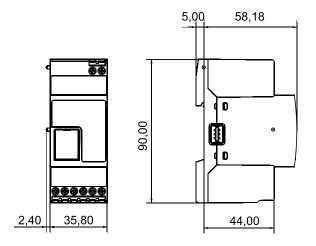

### **Environmental**

Operating temperature -20° to +50 °C (-4 ° to 122 °F)	
Storage temperature	-30° to +70 °C (-22 ° to +158 °F)
Humidity (non-condensing) 20 to 90% RH	



### **Power Supply**

Power Supply	15-28 V DC			
Consumption	≤ 5 W			
Battery	1 Metal-ion non-replaceable battery; 0.04 g			

Note: The device contains metal-ion batteries. For the sending, you must comply with the relevant packaging and labelling regulation.



#### Inputs/outputs insulation

Type of input/output	DC power supply	RS485 COM1	RS485 COM2	Ethernet	USB port "H"	USB port "D"	SH2UMMF124 and SH2DSP24
DC power supply	-	2 kV	2 kV	0.5 kV	0 kV	0 kV	0 kV
RS485 COM1	2 kV	-	0.5 kV	2 kV	2 kV	2 kV	2 kV
RS485 COM2	2 kV	0.5 kV	-	2 kV	2 kV	2 kV	2 kV
Ethernet	0.5 kV	2 kV	2 kV	-	0.5 kV	0.5 kV	0.5 kV
USB port "H"	0 kV	2 kV	2 kV	0.5 kV	-	0 kV	0 kV
USB port "D"	0 kV	2 kV	2 kV	0.5 kV	0 kV	-	0 kV
SH2DSP24	0 kV	2 kV	2 kV	0.5 kV	0 kV	0 kV	-

- 0 kV: inputs / outputs are not insulated.
- 2 kVrms: EN61010-1, IEC60664-1 over-voltage category III, pollution degree 2, double insulation on systems with max. 300 Vrms to ground.
- 0.5 kVrms: the insulation is functional type Mounting.



## Compatibility and conformity

	Electromagnetic compatibility (EMC) - immu	ectromagnetic compatibility (EMC) - immunity: EN61000-6-2				
Standards	Electromagnetic compatibility (EMC) - emissions: EN61000-6-3					
	Safety: EN60950					
	EMC 2014/30/EU					
Directives	LVD 2014/35/EU					
	RoHS 2011/65/EU					
Approvals	Qualified Device AWS IoT Core	Microsoft  Azure Certified Device				
	UK PSTI Compliance (Security Requirement	ents for Relevant Connectable Products).				



# **Ports**

## Ethernet

Standard	ISO9847	
LAN configuration	Static or DHCP	
LAN Comiguration	IP Address; Net Mask; Default Gateway, DNS (primary, secondary)	
Protocols  HTTP, HTTPS, FTP, FTPS, SFTP, Modbus TCP/IP, DP (Data SMTP, NTP, Azure IoT Hub, Amazon AWS, Sentilo, Modbus TCP/RTU, BACnet IP		
	WEB server: Port: 443 (by default); 5 connections	
Client connections	Tool: 1 connection	
	Modbus TCP/IP: 5 connections	
Connection type	RJ45 connector (10 Base-T, 100 Base-TX); maximum distance: 100 m	



## RS485

Number of ports	2	
F	COM1: Master or slave (gateway function)	
Function	COM2: Master	
Number of slaves	COM1: up to 64	
Number of Staves	COM2: up to 64	
Connections	2-wire. Max. distance 600 m	
Protocol	Modbus RTU	
Data format	Selectable: 1 start bit, 7/8 data bit, no/odd/even/ parity, 1/2 stop bit	
Baud rate Selectable: from 110 to 256000 bits/s		
Driver input capability	1/8 unit load	
Driver input capability	Up to 256 nodes on a network	



## ► USB

Type Hi-speed 2.0 Type-A		
Mode	Host	
Communication speed	<b>d</b> 60 MB/s	



Function Backup for disaster recovery		
Supported devices	USB mass storage: direct connection to UWP 3.0	
	USB modem/router: via additional module SH2DSP24	
Supported File System	ext4	
Note	Disabled automatically when SH2DSP24 is connected	

## Mini-USB

Туре	Hi-speed 2.0 mini-B	
Mode	Device	
Speed 60 MB/s		
Function	RNDIS (Virtual Ethernet)	
	Network Access via IP: 192.168.254.254	

### Micro SD slot

<b>Type</b> Industrial (from -25 to +85 °C / -13 to + 185 °F)	
Canacity	SD and SDHC
Capacity	Up to 32 GB
Function Backup for disaster recovery	
Supported File System	ext4



## ► HS bus

Bus type	RS485 high speed bus		
Function Connection to master channel generator modules (SH2MCG24, SH2WBU230x and SH2DUG24)			
Number of slaves	Maximum 7		
	By local bus on the right hand side		
Connection	Note: All the SH2MCG24, SH2WBU230x, SH2DUG24 and SBP2MCG324 modules have to be connected on the right hand side of the SH2WEB24.		
Termination Always required on the last module			
Max distance	600 m		



# **TCP/IP** ports

## Inbound communication

Port number	Description	Purpose
80	HTTP	Access to the internal web-server, API functions, Sentilo configuration
443	HTTPS	Access to the internal web-server, API function, Sentilo configuration
52325	SSH	Remote service (reserved to support personnel)
10000	UWP 3.0	Configuration and maintenance (UWP 3.0 Tool)
10002	UWP 3.0	Configuration and maintenance (UWP 3.0 Tool)
52326	UWP 3.0	Firmware and configuration update (UWP 3.0 Tool)



# Outbound communication

Port number	Description	Purpose
53	DNS	Domain name resolution
123	NTP	Network time services access
21	FTP	Data upload to FTP server
25	SMTP	Email message dispatching
80	HTTP	DP (data push communication)



## UCS bridge

Mode	Port	Description	
Secure	443	For the HTTPS connection for bridge opening.	
Insecure	503	Through any TCP Modbus client.  Note: this port is the default one. Users can change it from the Web-App relevant page.	
-	41214	Default port (to be enabled) for Modbus bridge.  Note: this port is the default one but users can change it.	



## Modbus TCP/IP

Function	TCP/IP port	Purpose
Modbus TCP/IP Slave	502 (selectable)	Modbus TCP data communication
Modbus bridge TCP/RTU	,	Bridge function for accessing (read and write) RTU meter connected to the UWP RTU ports

# **MAIA Cloud ports**



### Inbound communication (Through the tunnel)

Port number	Description	Purpose
80	HTTP	Access to the internal web-server, API functions, Sentilo configuration
443	HTTPS	Access to the internal web-server, API function, Sentilo configuration
52325	SSH	Remote service (reserved to support personnel)
10000	UWP 3.0	Configuration and maintenance (UWP 3.0 Tool)
10002	UWP 3.0	Configuration and maintenance (UWP 3.0 Tool)
52326	UWP 3.0	Firmware and configuration update (UWP 3.0 Tool)



### Outbound communication (Through the tunnel)

Port number	Description	Purpose
53	DNS	Domain name resolution
123	NTP	Network time services access
21	FTP	Data upload to FTP server
25	SMTP	Email message dispatching
80	HTTP	DP (data push communication)



## For tunnelling

Access	Ports
MAIA Cloud Web	443/tcp and 1194/udp
MAIA Cloud App software	443/tcp and 1194/udp

Note: through the tunnelling service, all the above-mentioned ports are supported.

# **Data management**

	INPUT from: Modbus RTU, Modbus TCP/IP, Dupline
Multi-BUS communication	OUTPUT to: Modbus RTU, Modbus TCP/IP, BACnet, Dupline, DALI
Embedded Database	Embedded database for storing system configuration, variables, events
	Flexible data model based on signals definition and functions creation
Automation server	Automation server for exchanging data with other systems via: FTP, SFTP, FTPS, Rest-API, SMTP, MQTT, Sentilo

\*Note: Data stored on the internal UWP 3.0 database (including logged data points, events and configuration parameters) are preserved in the case of system shut-down. UWP 3.0 storage memory size is 4.0 GB (including all the logged data points, events and configuration parameters).

## Software and interfaces

#### **MAIA Cloud**

Remote access is the key to minimize the Total Cost Of Ownership of an UWP 3.0 powered installation; by leveraging the networking capabilities of MAIA Cloud, it is possible to take control of remote installations without leaving your office.



#### **Benefits**

- Reduced costs. Thanks to the VPN safe remote access, users do not need to travel and consequently waste money and time to solve their customers' issues.
- · Easy automatic remote networking
- · Hassle free regardless of destination and IP address.



#### **Main functions**

- Authentication: MAIA Cloud users can remotely access their UWP 3.0 fleets and manage them if needed.
- Security. Remote connections to MAIA Cloud and to the remote UWP 3.0 Edge units thanks to encrypted tunnelling.
- Hassle-free. Thanks to the MAIA Cloud tunnelling functions, you do not need to worry about IP address changes and firewalls. You could always access your device, according to your security policies.
- · Remote set-up and operation. Thanks to MAIA Cloud, it is possible now to remotely:

Set-up of any Modbus/RTU CG Meter (via UCS)

Set-up of any Modbus/TCP CG meter (via UCS)


Set-up of any Smart Dupline item (via UWP 3.0 Tool)

Establishment of a VPN connection to your PC


Surfing on the UWP 3.0 web-interface.



### Architecture

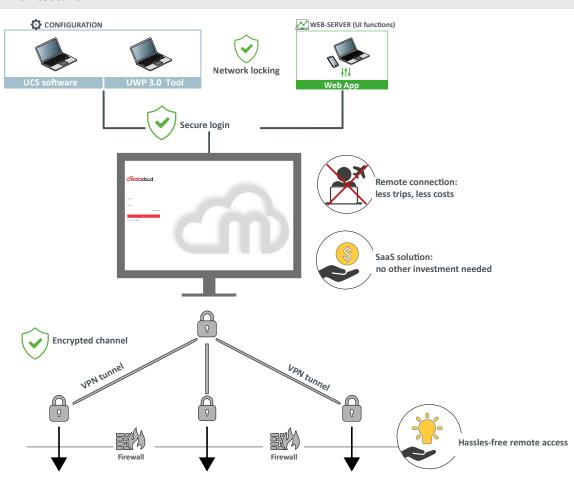




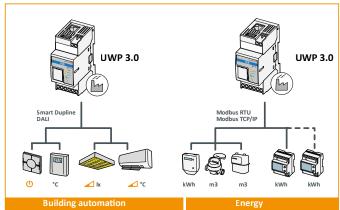

## **UWP 3.0 Tool**

UWP 3.0 Tool is the UWP 3.0 configuration software. It allows the user to:

- · carry out the system commissioning
- · define the automation and control logics
- set the measuring instruments and sensors monitoring.

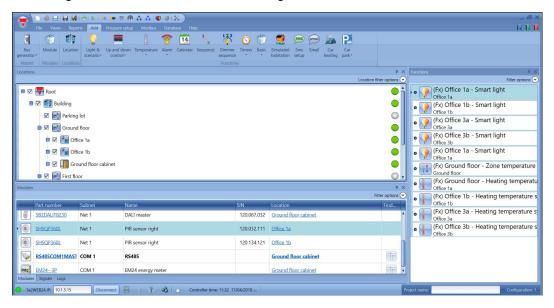

#### **Main functions**

- · Configure interfaces and communication protocols
- · Execute the Dupline modules automatic scan for fast commissioning
- · Configure and manage the connected modules
- · Define the control and automation functions
- Generate a driver to monitor third party Modbus devices
- Set the data and events collection and storage from Carlo Gavazzi or third party instruments
- Develop Modbus drivers for UWP 3.0 with both reading and writing functions for any Modbus device
- · Save a configuration offline for backup or any subsequent use
- · Disaster recovery via scheduled or on-demand triggers



# **UWP 3.0 Web App**

The UWP 3.0 Web App is the UWP 3.0 Web Interface, accessible through Web browsers from mobile or desktop devices. Through widgets contained in predefined and customised dashboards, it allows the user to:

- · view and export collected data
- · control the automation functions
- · define specific settings (User Interface and Server Automation).



# Main functions

- · View collected data as real time values or charts
- · Generate data and events reports
- Manage and adjust the functions parameters (e.g. modify temperature set points)
- Send commands (e.g. switching on/off or select scenarios)
- Configure Data Push Services to FTP/SFTP/FTPS servers or Em<sup>2</sup>-Server (Carlo Gavazzi)
- Configure MQTT link to IoT Hubs (Amazon AWS and Microsoft Azure)
- Learn the main tasks by using the embedded tutorial



# Cybersecurity



#### Introduction

Cybersecurity is the practice of protecting systems, networks, and programs from digital attacks. These cyberattacks are usually aimed at:

- accessing, changing, or destroying sensitive information;
- extorting money from users;
- interrupting normal business processes.

Implementing effective cybersecurity measures is particularly challenging today because there are more devices than people, and attackers are becoming more innovative.

For UWP 3.0 SE (Security Enhanced), the security capabilities have been verified by UL to Level SILVER.

The SILVER rating certifies the enhanced security capabilities of UWP 3.0 SE regarding:

- Access Control
- Industry Privacy Best Practices
- Product Security Maintenance.







#### **Pillars**

- Disaster recovery. UWP 3.0 includes a solid disaster recovery system for saving and restore both configuration and history data on USB stick, SD card, SFTP server.
- Easy upgrade function. UWP 3.0 Tool and web app notify users about the availability of a new software and firmware version; the whole upgrade process is managed by the UWP 3.0 Tool.
- UWP secure bridge function. It permits you to establish a secure connection through LAN or Internet network between the UCS software and Carlo Gavazzi Modbus meters connected to UWP 3.0 via RS485 or LAN network. This way, you can perform the following tasks remotely:
- configure a wired device via UCS without disconnecting UWP 3.0;
- check the proper functioning of the devices, the real time measures, the status of alarms and the inputs/outputs
- modify or correct the configuration parameters, in case of measures anomalies or of project structure changes.



- Secure access: thanks to MAIA Cloud, you can access a UWP 3.0 system through a secure VPN (virtual private network).
- Minimalist approach: UWP 3.0 has been designed to include only the necessary sub-systems into a highly optimized linux core, so to avoid unnecessary risks due to attacks to unmonitored services.

For further information, refer to the following guideline: "Security in energy monitoring and building automation applications based on the UWP 3.0 ecosystem".



# **Connection diagrams**

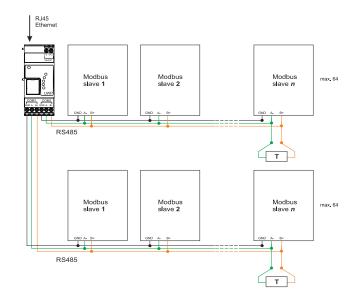


Fig. 1 Modbus RTU connection. COM 1 master, COM 2 master


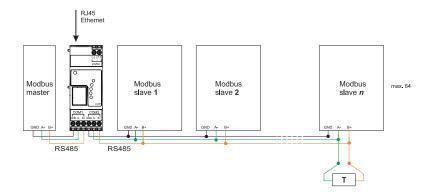


Fig. 2 Modbus RTU connection. COM 1 slave, COM 2 master





## Fig. 3 Example of Smart Dupline modules connection using master channel generators




Fig. 4 Power Supply





COPYRIGHT ©2024

Content subject to change. Download the updated version: www.gavazziautomation.com